

ARMY RESEARCH LABORATORY



# Spectroscopic Investigation of Atmospheric Pressure Counterflow Diffusion Flames Inhibited by Halons

Kevin L. McNesby  
Robert G. Daniel  
Jeffrey M. Widder  
Andrzej W. Miziolek

ARL-TR-857

September 1995



APPROVED FOR PUBLIC RELEASE; DISTRIBUTION IS UNLIMITED.

19951012 001

DTIC QUALITY INSPECTED 6

## **NOTICES**

Destroy this report when it is no longer needed. DO NOT return it to the originator.

Additional copies of this report may be obtained from the National Technical Information Service, U.S. Department of Commerce, 5285 Port Royal Road, Springfield, VA 22161.

The findings of this report are not to be construed as an official Department of the Army position, unless so designated by other authorized documents.

The use of trade names or manufacturers' names in this report does not constitute indorsement of any commercial product.

# REPORT DOCUMENTATION PAGE

Form Approved  
OMB No. 0704-0188

Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden, to Washington Headquarters Services, Directorate for Information Operations and Reports, 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302, and to the Office of Management and Budget, Paperwork Reduction Project (0704-0188), Washington, DC 20503.

1. AGENCY USE ONLY (Leave blank)		2. REPORT DATE September 1995	3. REPORT TYPE AND DATES COVERED Final, May 94-Apr 95	
4. TITLE AND SUBTITLE Spectroscopic Investigation of Atmospheric Pressure Counterflow Diffusion Flames Inhibited by Halons			5. FUNDING NUMBERS PR: 1L161102AH43	
6. AUTHOR(S) Kevin L. McNesby, Robert G. Daniel, Jeffrey M. Widder, and Andrzej W. Miziolek				
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) U.S. Army Research Laboratory ATTN: AMSRL-WT-PC Aberdeen Proving Ground, MD 21005-5066			8. PERFORMING ORGANIZATION REPORT NUMBER ARL-TR-857	
9. SPONSORING / MONITORING AGENCY NAME(S) AND ADDRESS(ES)			10. SPONSORING / MONITORING AGENCY REPORT NUMBER	
11. SUPPLEMENTARY NOTES				
12a. DISTRIBUTION / AVAILABILITY STATEMENT Approved for public release; distribution is unlimited.			12b. DISTRIBUTION CODE	
13. ABSTRACT (Maximum 200 words) Infrared spectra of atmospheric pressure counterflow diffusion flames inhibited by Halons and a few of their potential replacements are measured using Fourier transform spectroscopy. Results are compared to spectra of similar flame systems examined at low pressure. It is shown that for atmospheric pressure counterflow diffusion methane/air flames inhibited by CF <sub>3</sub> Br, CF <sub>2</sub> H <sub>2</sub> , and CF <sub>4</sub> , the two major fluorine-containing combustion products are HF and CF <sub>2</sub> O. A correlation is shown between flame inhibition efficiency and CF <sub>2</sub> O formation for atmospheric pressure counterflow diffusion flames inhibited by these Halons. For low-pressure premixed flames inhibited by CF <sub>3</sub> Br, HF appears to be the only fluorine-containing combustion product, even at relative dopant levels 15 times higher than those capable of extinguishing atmospheric pressure counterflow diffusion flames. The results of these experiments illustrate the need for flame inhibitor testing over a wide spectrum of flame conditions, while providing further evidence that for atmospheric pressure inhibition of real fires by Halons, CF <sub>2</sub> O may be a good indicator of inhibitor efficiency when that inhibition is at least partly accomplished by chemical scavenging of reactive combustion intermediates.				
14. SUBJECT TERMS flame inhibition, halon replacement, Fourier transform infrared (FT-IR) spectroscopy, diffusion flames			15. NUMBER OF PAGES 24	
			16. PRICE CODE	
17. SECURITY CLASSIFICATION OF REPORT UNCLASSIFIED	18. SECURITY CLASSIFICATION OF THIS PAGE UNCLASSIFIED	19. SECURITY CLASSIFICATION OF ABSTRACT UNCLASSIFIED	20. LIMITATION OF ABSTRACT SAR	

INTENTIONALLY LEFT BLANK.

## ACKNOWLEDGMENT

The authors wish to acknowledge the support of the Strategic Environmental Research and Development Program (SERDP) of the U.S. Department of Defense (DOD). We would also like to thank Dr. Anthony Hamins of NIST for the loan of the counterflow diffusion burner.

Accession For	
NTIS CRA&I	<input checked="checked" type="checkbox"/>
DTIC TAB	<input type="checkbox"/>
Unannounced	<input type="checkbox"/>
Justification .....	
By .....	
Distribution /	
Availability Codes	
Dist	Avail and/or Special
A-1	

INTENTIONALLY LEFT BLANK.

## TABLE OF CONTENTS

	<u>Page</u>
ACKNOWLEDGMENT .....	iii
LIST OF FIGURES .....	vii
1. INTRODUCTION .....	1
2. EXPERIMENTAL .....	2
2.1 Atmospheric Pressure Counterflow Diffusion Burner .....	2
2.2 Low-Pressure Burner .....	3
2.3 FT-IR Spectrometer .....	3
3. RESULTS AND DISCUSSION .....	5
4. CONCLUSION .....	10
5. REFERENCES .....	13
DISTRIBUTION LIST .....	15

INTENTIONALLY LEFT BLANK.



## LIST OF FIGURES

<u>Figure</u>	<u>Page</u>
1. A schematic of the atmospheric pressure counterflow diffusion burner used in these experiments .....	3
2. A schematic of the low-pressure burner apparatus used in these experiments, showing the burner inside the evacuable chamber .....	4
3. The FT-IR absorbance spectrum measured through an atmospheric pressure counterflow diffusion methane/air flame .....	6
4. The FT-IR absorbance spectrum measured through an atmospheric pressure counterflow diffusion methane/air flame doped with 1.0% CF <sub>3</sub> Br .....	6
5. The FT-IR absorbance spectra measured through an atmospheric pressure counterflow diffusion methane/air flame doped with successively increasing amounts of CF <sub>3</sub> Br. Note the increase in the CF <sub>2</sub> O feature near 1,950 cm <sup>-1</sup> .....	7
6. The FT-IR absorbance spectra measured through an atmospheric pressure counterflow diffusion methane/air flame doped with CF <sub>3</sub> Br, CF <sub>2</sub> H <sub>2</sub> , and CF <sub>4</sub> .....	7
7. The FT-IR absorbance spectra measured through an atmospheric pressure counterflow diffusion methane/air flame doped with 1.0% CF <sub>4</sub> and an atmospheric pressure counterflow diffusion methane/oxygen flame doped with 1.0% CF <sub>4</sub> .....	8
8. The FT-IR absorbance spectra measured through a low-pressure methane/oxygen flame with and without 2.6% CF <sub>3</sub> Br added to the premixture .....	9
9. The FT-IR absorbance spectrum measured through a low-pressure methane/oxygen flame with 15% CF <sub>3</sub> Br added to the premixture .....	9

INTENTIONALLY LEFT BLANK.

## 1. INTRODUCTION

Because of concern over the depletion of stratospheric ozone, production and sale of the widely used Halon 1301 ( $\text{CF}_3\text{Br}$ ) and Halon 1211 ( $\text{CF}_2\text{ClBr}$ ) have been banned (Copenhagen 1987) as of 1 January 1994. A search is presently underway for suitable replacements. To be an acceptable replacement, the new inhibitor must have high fire suppression efficiency, low toxicity, zero residue, compact storage capability, rapid dispersion upon release, and high materials and systems compatibility (Philipczak 1993). The need for environmentally friendly alternatives equal to, or surpassing, the flame inhibition efficiency of Halons 1301 and 1211 is especially important for critical applications encountered in the military. Scenarios range from extinguishment of electrical fires in computer facilities to suppression of a mist-fireball explosion in an armored vehicle following penetration of the fuel cell by a projectile (Finnerty and Polyanski 1993).

The overall goal of the Halon (a contraction of halogenated hydrocarbon) alternatives work being conducted at the U.S. Army Research Laboratory (ARL) is the experimental validation of halogen flame mechanisms developed at the National Institute of Standards and Technology (NIST) (Burgess et al. 1994). Once validated, these models will be used to predict inhibitor efficiency and toxic gas by-product formation. The experimental approach employed at ARL uses infrared tunable diode laser (TDL) (Hanson and Falcone 1978) and Fourier transform infrared (FT-IR) spectroscopies to measure in-situ flame temperatures and concentrations of species participating in the combustion occurring in low-pressure premixed and atmospheric pressure counterflow diffusion flames doped with small amounts of Halons and candidate Halon alternatives. Vibrational spectroscopy was chosen as the diagnostic technique because the measurement does not perturb the flame, and because nearly all of the combustion participants (with the exception of homonuclear diatomics) may be observed in simple infrared absorption spectra.

The two flame systems were selected for different reasons. Flat, low-pressure laminar flow premixed-gas flames are used because at low pressure, flame regions are expanded. This expansion provides better spatial resolution for probing preheating and combustion flame zones (Biordi, Lazzara, and Papp 1975). Atmospheric pressure counterflow diffusion flames are used because these flames may closely approximate real fire scenarios, where diffusion and nonpremixed combustion are important (Linteris, in press [a]). The experimental protocol involves qualitative flame species measurements using FT-IR spectroscopy, while spectral temperature (Ouyang, Varghese, and Cline 1989) and species concentration flame profiles are determined using tunable diode laser spectroscopy. Results from experiments in our lab using diode laser absorption spectroscopy have been reported elsewhere (Daniel et al. 1994).

A drawback to the use of FT-IR spectroscopy for the investigation of inhibited flames is the limited spatial resolution afforded by the polychromatic probe beam. Although the output beam waist may be apertured to less than 1 mm, this results in significant loss of throughput, which decreases the signal-to-noise ratio in the spectra. This combination makes obtaining spatially resolved information difficult. Still, it should be pointed out that some researchers have had success obtaining spatial resolution through combustor systems using FT-IR spectroscopy (Solomon et al. 1986; McNesby and Fifer 1993). Although no effort is made here to quantify spectra of inhibited flames measured using FT-IR spectroscopy, significant insight into the nature of flame inhibition may be gained from qualitative interpretation of FT-IR spectra. This insight into the nature of the inhibited flame is the subject of this report.

## 2. EXPERIMENTAL

2.1 Atmospheric Pressure Counterflow Diffusion Burner. The atmospheric pressure counterflow diffusion burner is shown schematically in Figure 1. The burner assembly was fabricated at NIST. A brief explanation of the operation of the apparatus is as follows. Fuel (methane) is flowed at atmospheric pressure into the flame region from below. Oxidizer (oxygen or air) and inhibitor is flowed into the flame region from above. The flame appears as a thin, flat luminous disc (with slight edge curvature pointing up toward the exhaust shroud) located between the fuel and oxidizer ports. Flame position in the volume between fuel and oxidizer ports is determined by gas flow rates and stoichiometry. For neat methane/oxygen flames using equal fuel and oxidizer flow rates, the flame disc is located nearer to the oxidizer port because of the stoichiometry of the methane/oxygen combustion reaction. All gases are exhausted from the flame region through an exhaust port that forms a shroud around the oxidizer port.

For the flames studied using the atmospheric pressure counterflow diffusion burner, typical flow rates were 600 ml/min oxygen and 500 ml/min methane. When air was used as the oxidizer, the air flow rate was 2.2 l/min and the methane flow rate was 1.1 l/min. Inhibitor flow varied up to a maximum of 1.3% of the total flow for each system investigated. These flow parameters were selected because they gave the most stable flame for that particular fuel/oxidizer combination.

Flow was controlled by an MKS Instruments Inc. type 147B gas flow controller. Although the burner exhaust shroud was connected to a high-volume vacuum pump, it was necessary to contain the atmospheric pressure counterflow diffusion burner within a large box equipped with optical ports and a chimney attached to a fume hood. This arrangement was to prevent noxious fumes (HF and  $\text{CF}_2\text{O}$ ) from entering the main laboratory.

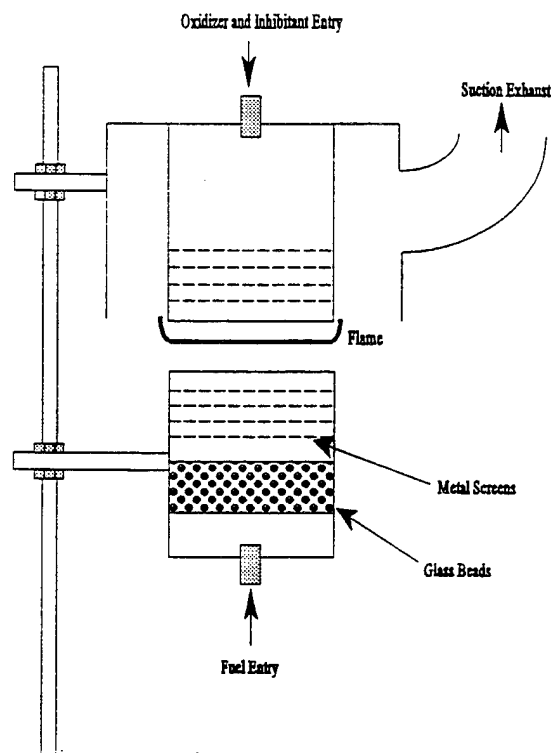


Figure 1. A schematic of the atmospheric pressure counterflow diffusion burner used in these experiments.

**2.2 Low-Pressure Burner.** Most of the low-pressure burner experimental apparatus has been described in a previous publication (Daniel, McNesby, and Miziolek 1993). The low-pressure premixed methane/oxygen flame was supported on a water-cooled, 6-cm-diameter stainless steel fritted, flat flame burner (McKenna Industries). Gases were mixed just prior to entering a final mixing chamber immediately below the fritted burner head. Gas flow was controlled by an MKS type 147B gas flow controller. The low-pressure burner was mounted on a translational stage, which was mounted to a linear motion feedthrough. This low-pressure burner assembly was contained in an evacuable chamber equipped with  $\text{CaF}_2$  windows. Pressure was maintained within the chamber by a Heraeus-Leybold Model SV-100 rotary vacuum pump and controlled using an electrically actuated MKS type 253A butterfly valve. Pressure inside the chamber was monitored using MKS type 390 capacitance manometers. Typical flow rates were 200 ml/min oxygen and 100 ml/min methane. Halon flow rates varied up to 15% of the total flow. Typical pressure within the chamber during collection of flame spectra was 20 torr. The experimental apparatus is shown in Figure 2.

**2.3 FT-IR Spectrometer.** The FT-IR spectrometer was manufactured by Mattson Instruments. All counterflow diffusion flame spectra were measured at  $4 \text{ cm}^{-1}$  resolution employing triangular apodization

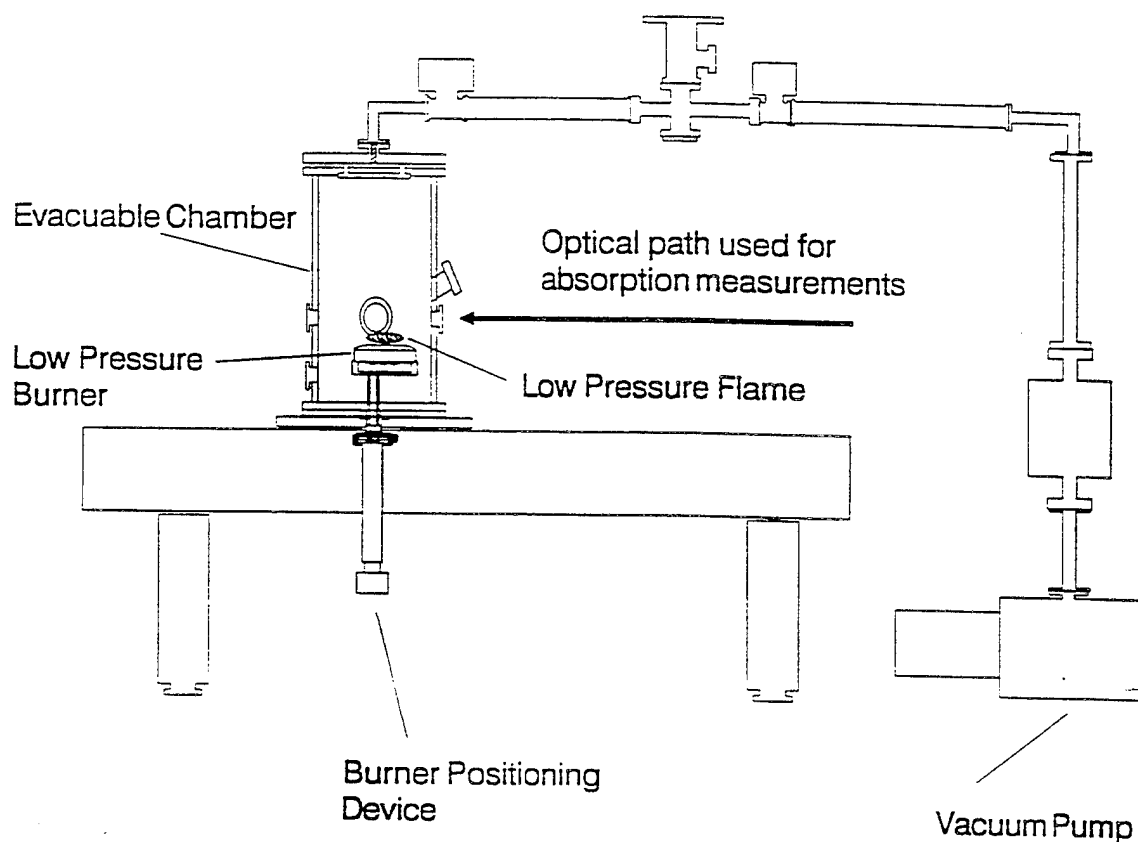


Figure 2. A schematic of the low-pressure burner apparatus used in these experiments, showing the burner inside the evacuatable chamber.

using coaddition of 128 scans. Total scan time was approximately 4 min. The infrared beam path was not purged for these experiments. Each single beam flame spectrum was ratioed to a spectrum measured over the same path, but with no flame or fuel/oxidizer/inhibitor mixture present. Since the minimum beam waist diameter of the spectrometer was approximately equal to the distance between fuel and oxidizer ports in the counterflow diffusion burner (see Figure 1), no spatial resolution within the flame was possible, and the resultant spectra show both precursors (fuel and inhibitor) and combustion products.

For the low-pressure experiments, spectra were measured at  $1\text{ cm}^{-1}$  resolution, employing triangular apodization using coaddition of 500 scans. Total scan time was approximately 20 min. The infrared probe beam path was purged with dry nitrogen, and each single beam flame spectrum ratioed to a spectrum through the purged beam path with no flame present and the low-pressure chamber evacuated. The probe beam aperture was set to a diameter of 4 mm when passing through the low-pressure chamber. Since the beam position of the infrared probe was fixed, spectra of different lines-of-sight through the low-pressure flame were measured by moving the burner assembly within the evacuatable chamber.

For each set of experiments, reflection of infrared emission through the spectrometer and back onto the detector was checked by collecting spectra with the tungsten carbide filament turned off. In all cases, no interferometer-modulated emission was observed. All gases used in these experiments were of spectral purity and were obtained from Matheson, Inc., except for the  $\text{CF}_3\text{Br}$ , which was obtained from PCR Inc. All gases were used as supplied without further purification.

### 3. RESULTS AND DISCUSSION

Figure 3 shows the absorbance spectrum through an atmospheric pressure counterflow diffusion methane/air flame with no agent added. The methane fuel is the most prominent feature in the spectrum. Figure 4 shows the same flame doped through the oxidizer port side with 1.0%  $\text{CF}_3\text{Br}$ . Addition of  $\text{CF}_3\text{Br}$  beyond 1% of the total flow causes flame flicker and eventual extinguishment, in agreement with previous studies of diffusion flame extinguishment by  $\text{CF}_3\text{Br}$  (Bajpai 1974). Interesting features of this spectrum are the presence of carbonyl difluoride ( $\text{CF}_2\text{O}$ ), near  $1,950\text{ cm}^{-1}$ , hydrogen fluoride (HF), near  $3,700\text{ cm}^{-1}$ , and Halon 1301 ( $\text{CF}_3\text{Br}$ ), near  $1,200\text{ cm}^{-1}$ . Both HF and  $\text{CF}_2\text{O}$  are highly toxic and corrosive gases (Sheinson, Musick, and Carhart 1981); therefore, care must be exercised when doping any flame with Halon 1301 when extinguishment is either not a goal or does not occur immediately. Figure 5 shows spectra of the atmospheric pressure methane/air counterflow diffusion flame with successive additions of Halon 1301. It is evident from these spectra that  $\text{CF}_2\text{O}$  formation in these flames is dependent upon the Halon 1301 dopant level.

Figure 6 shows spectra of atmospheric pressure counterflow diffusion methane/air flames doped at the 1% level with Halon 1301 ( $\text{CF}_3\text{Br}$ ), 1.3%  $\text{CF}_4$ , and 1.3%  $\text{CF}_2\text{H}_2$ . For the  $\text{CF}_2\text{H}_2$  doped flame, there is a considerable amount of HF formation near  $3,700\text{ cm}^{-1}$ . For the  $\text{CF}_4$  doped flame, there is no indication of HF or  $\text{CF}_2\text{O}$  formation, presumably because the CF bond in  $\text{CF}_4$  is not broken in the flame (Linteris, in press [b]). The degree to which  $\text{CF}_2\text{O}$  is formed in the atmospheric pressure methane/air counterflow diffusion flames doped with  $\text{CF}_3\text{Br}$ ,  $\text{CF}_2\text{H}_2$ , and  $\text{CF}_4$  parallels their efficiency as flame inhibitors determined using cup burner experiments ( $\text{CF}_3\text{Br} > \text{CF}_3\text{H} > \text{CF}_2\text{H}_2 > \text{CF}_4$ ) (Linteris, in press [b]).

Figure 7 shows spectra of atmospheric pressure methane/air and methane/oxygen counterflow diffusion flames doped with  $\text{CF}_4$ . The hotter methane/oxygen flame shows significant HF formation, indicating cleavage of the C-F bond in  $\text{CF}_4$ . It should be noted that there is no spectral evidence of  $\text{CF}_2\text{O}$  formation in this flame, even though HF is formed. For this reason, we believe that it is questionable to correlate HF formation with inhibitor efficiency.

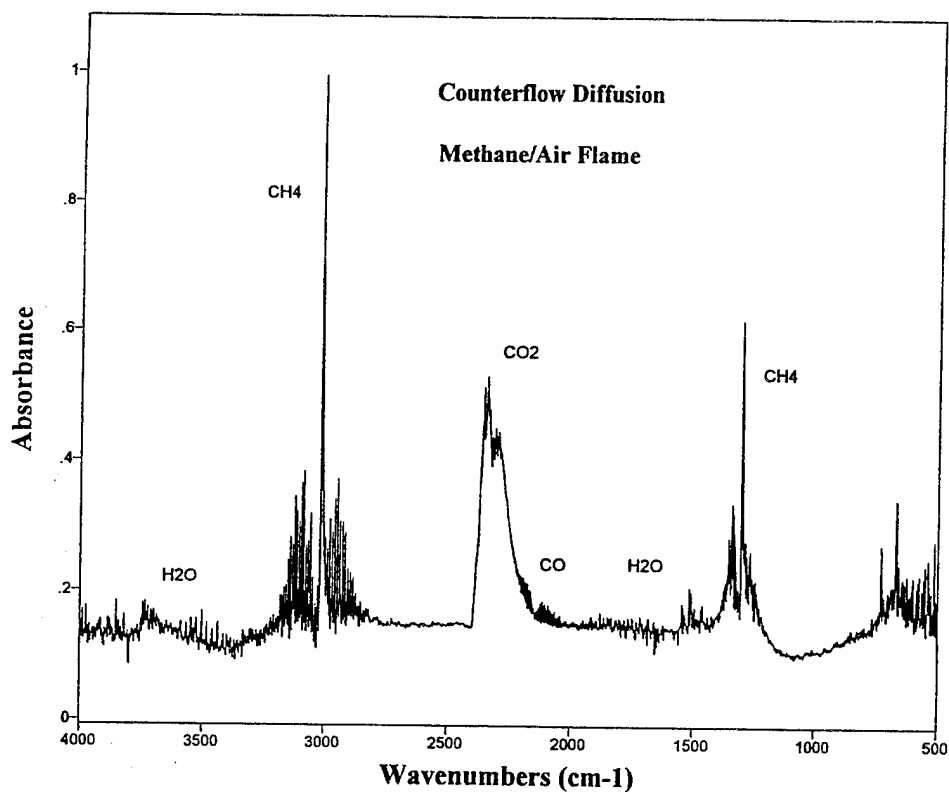


Figure 3. The FT-IR absorbance spectrum measured through an atmospheric pressure counterflow diffusion methane/air flame.

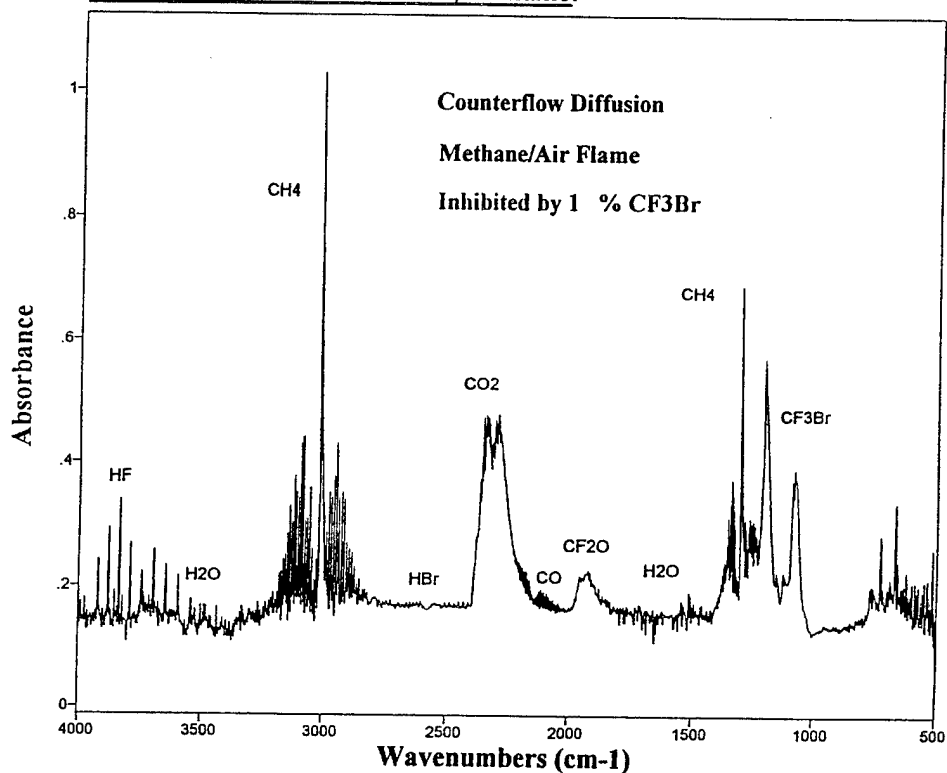


Figure 4. The FT-IR absorbance spectrum measured through an atmospheric pressure counterflow diffusion methane/air flame doped with 1.0% CF<sub>3</sub>Br.



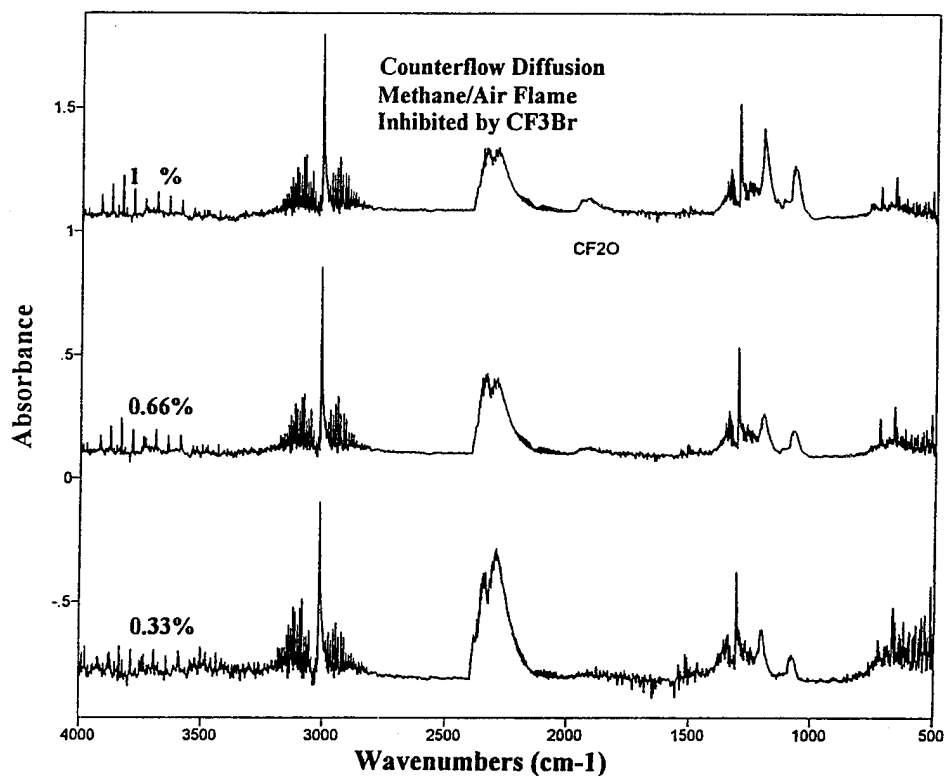


Figure 5. The FT-IR absorbance spectra measured through an atmospheric pressure counterflow diffusion methane/air flame doped with successively increasing amounts of CF<sub>3</sub>Br. Note the increase in the CF<sub>2</sub>O feature near 1950 cm<sup>-1</sup>.

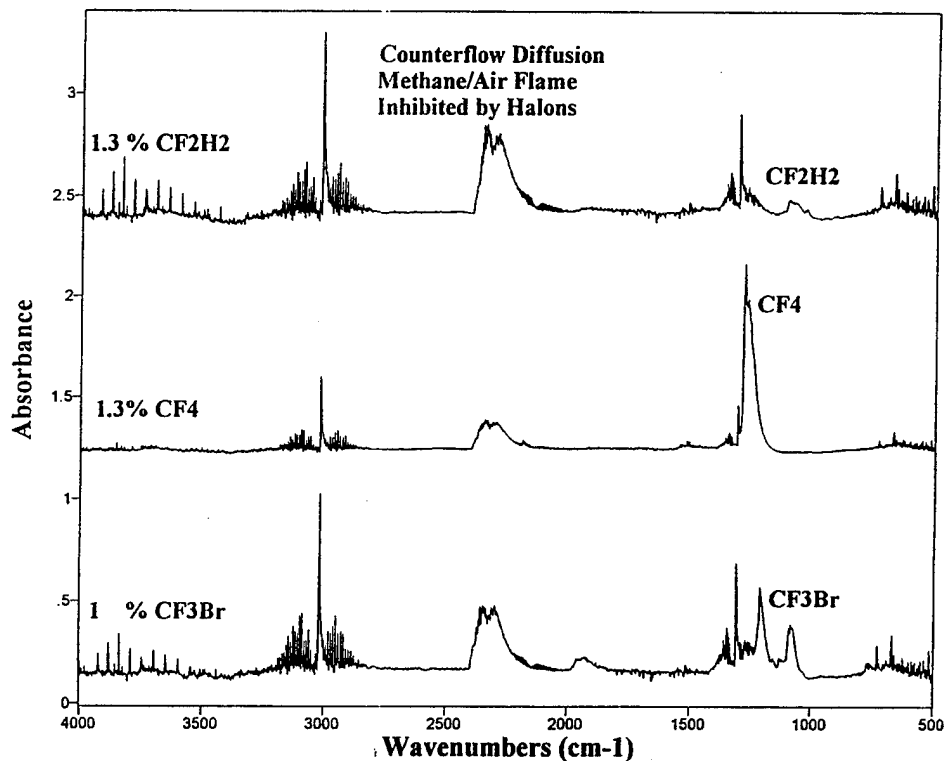


Figure 6. The FT-IR absorbance spectra measured through an atmospheric pressure counterflow diffusion methane/air flame doped with CF<sub>3</sub>Br, CF<sub>2</sub>H<sub>2</sub>, and CF<sub>4</sub>.

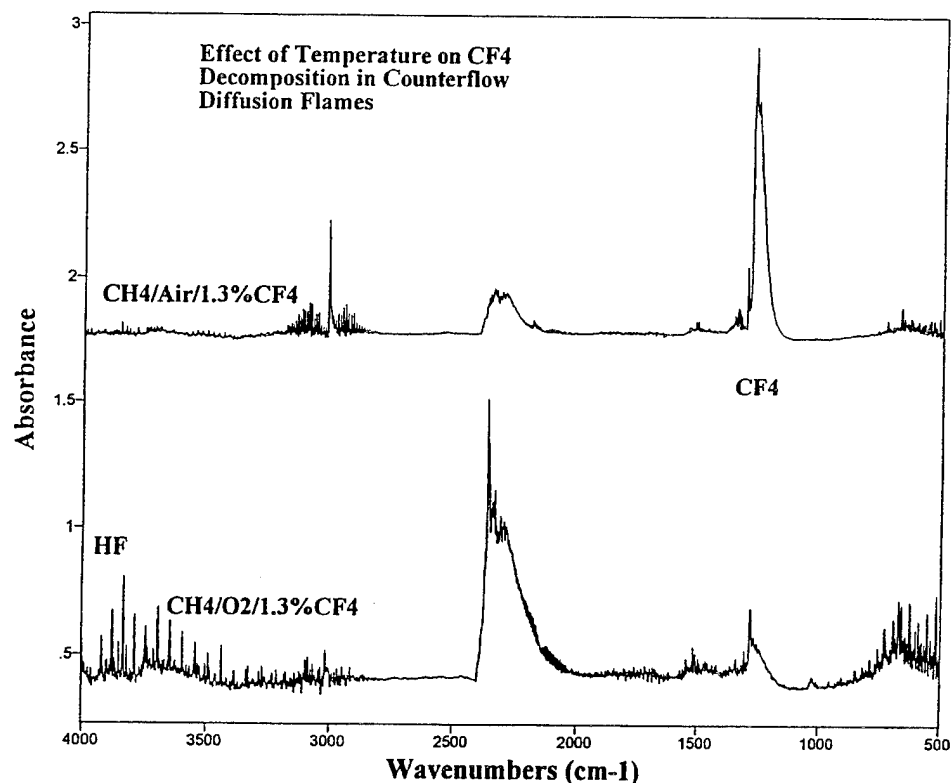


Figure 7. The FT-IR absorbance spectra measured through an atmospheric pressure counterflow diffusion methane/air flame doped with 1.0%  $\text{CF}_4$  and an atmospheric pressure counterflow diffusion methane/oxygen flame doped with 1.0%  $\text{CF}_4$ .

Figure 8 shows the spectra of a low-pressure premixed-gas stoichiometric methane/oxygen flame with and without addition of 2.6%  $\text{CF}_3\text{Br}$ . In contrast to the counterflow diffusion atmospheric pressure methane/air flame doped with  $\text{CF}_3\text{Br}$ , the low-pressure flame shows no evidence of  $\text{CF}_2\text{O}$  formation near  $1,950\text{ cm}^{-1}$ . Figure 9 shows the spectrum of the low-pressure premixed-gas methane/oxygen flame doped with 15%  $\text{CF}_3\text{Br}$ . Evident from this spectrum is copious HF formation near  $3,700\text{ cm}^{-1}$  and significant HBr formation near  $2,600\text{ cm}^{-1}$ . However, even at this high  $\text{CF}_3\text{Br}$  dopant level, there is no indication of  $\text{CF}_2\text{Br}$  formation at any probe beam position within the flame.

Tunable diode laser infrared absorption measurements of low-pressure flames inhibited by  $\text{CF}_3\text{Br}$  have shown that  $\text{CF}_2\text{O}$  is formed and then rapidly consumed. Modeling studies of these results indicate that at high temperatures,  $\text{CF}_2\text{O}$  is decomposed before leaving the luminous zone of the flame (Miziolek et al., in press). We believe that with line-of-sight spatial resolution of less than 1 mm and spectral resolution better than  $1\text{ cm}^{-1}$ ,  $\text{CF}_2\text{O}$  would have been detected in these flames using FT-IR spectroscopy.

It is noteworthy that Halon 1301 was unable to extinguish a low-pressure premixed gas stoichiometric methane/oxygen flame even at percent total flow levels 15 times higher than those required to extinguish

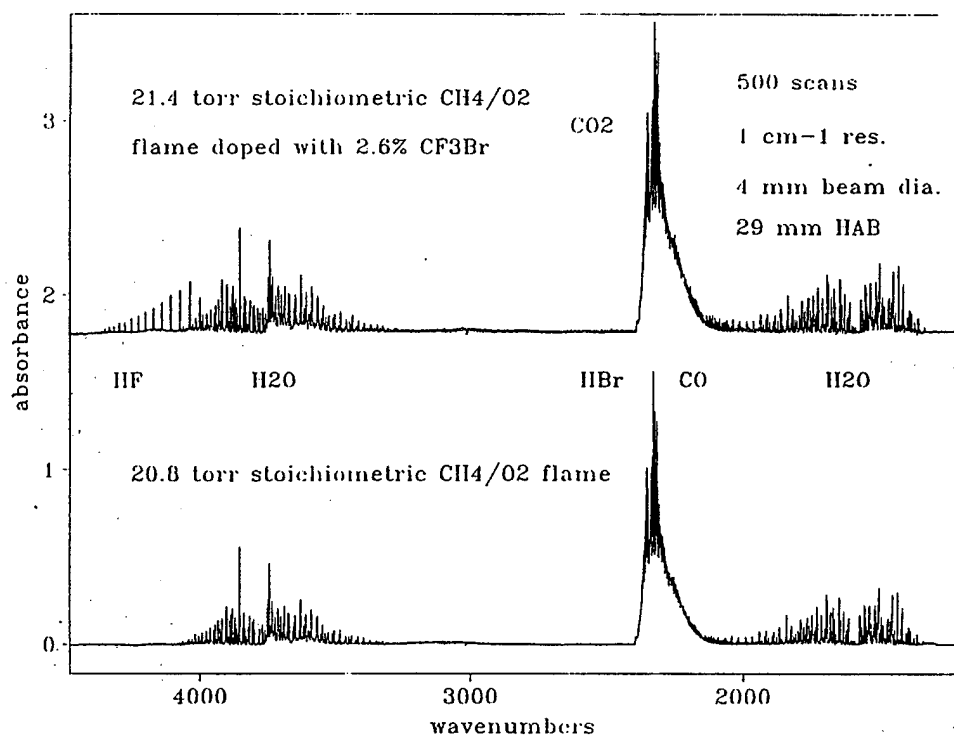


Figure 8. The FT-IR absorbance spectra measured through a low-pressure methane/oxygen flame with and without 2.6% CF<sub>3</sub>Br added to the premixture.

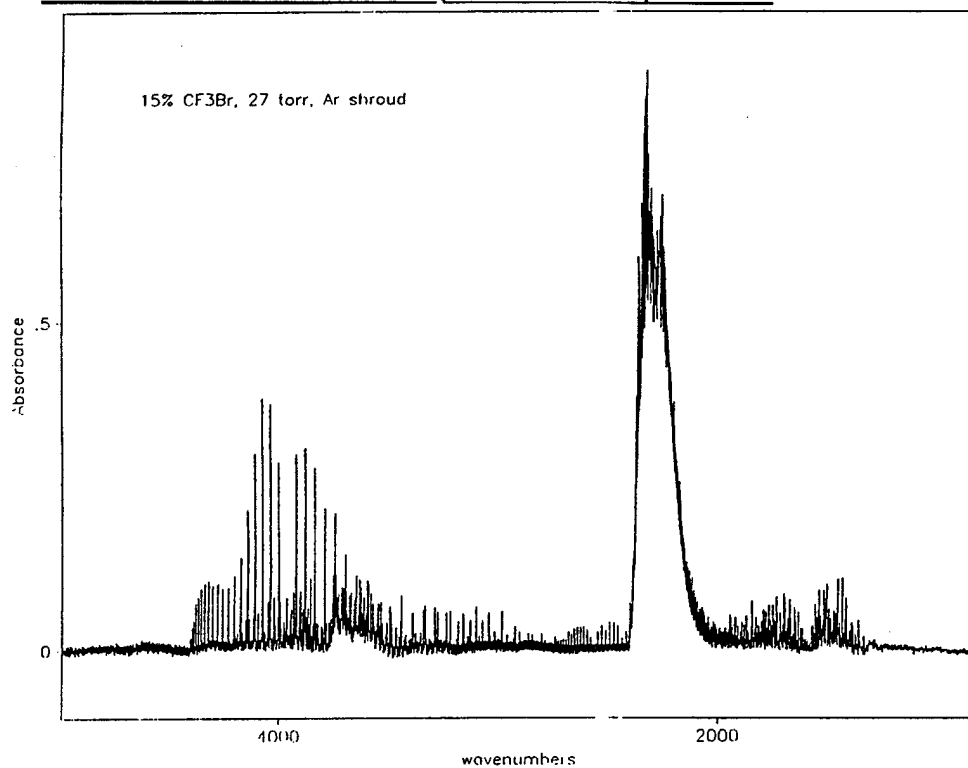


Figure 9. The FT-IR absorbance spectrum measured through a low-pressure methane/oxygen flame with 15% CF<sub>3</sub>Br added to the premixture.

atmospheric pressure counterflow diffusion flames. This suggests that the inhibiting effect of Halon 1301 may be most important in flame regions where combustion is nonstoichiometric and diffusion fed. These conditions describe most "real" fires.

Finally, from Figures 4, 8, and 9, it should be noted (assuming similar infrared absorption cross sections for HF and HBr) that there is much less HBr formation than would be expected based on the amounts of HF formation and the molecular formula of Halon 1301 ( $\text{CF}_3\text{Br}$ ). This supports calculations that show the rapid removal of HBr from the flame system by reaction (Safieh, Vandooren, and Tiggelin 1982) with H and OH, and the formation of molecular bromine, which is not observable using infrared absorption spectroscopy.

#### 4. CONCLUSION

Although the data are somewhat limited, we believe several conclusions may be reached. Most importantly, we believe the data show that inhibitor effect is highly dependent on the type of combustion system being investigated. Specifically, for atmospheric pressure counterflow diffusion methane/air flames inhibited by  $\text{CF}_3\text{Br}$ , large amounts of  $\text{CF}_2\text{O}$  are observed.

Conversely, for low-pressure premixed-gas stoichiometric laminar methane/oxygen flames inhibited by  $\text{CF}_3\text{Br}$ , no measurable (by FT-IR)  $\text{CF}_2\text{O}$  is observed. This suggests that inhibition of real flames by Halon 1301 may be most important in regions of nonstoichiometric combustion.

Additionally,  $\text{CF}_2\text{O}$  may be a good indicator of the degree of chemical flame inhibition by Halons. Also, it appears that although  $\text{CF}_4$  may decompose in hot flames to yield HF, the absence of  $\text{CF}_2\text{O}$  formation indicates that  $\text{CF}_4$  does not participate in flame inhibition by the radical scavenging mechanism assumed to be responsible for chemical flame inhibition by Halon 1301. Finally, both low-pressure and atmospheric pressure flames inhibited by Halon 1301 show less HBr formation than would be expected based solely upon the amount of HF observed and the molecular formula of the inhibitor ( $\text{CF}_3\text{Br}$ ). This supports the mechanism of rapid HBr removal from the flame via reactions with H and OH, and the conversion of Br atoms to molecular bromine.

We believe that this rather straightforward experimental setup is a valuable tool and may be used to see differences in flame inhibition of real fires by different agents. The technique may be a useful screening test for candidate replacement agents prior to full-scale testing. We are presently engaged in

the construction of a new counterflow diffusion burner that will provide larger flame surface area and be capable of low-pressure operation.

INTENTIONALLY LEFT BLANK.

## 5. REFERENCES

- Bajpai, S. N. Journal of Fire and Flammability, vol. 5, p. 255, 1974.
- Biordi, J. C., C. P. Lazzara, and J. F. Papp. "Halogenated Fire Suppressants." ACS Symposium Series 16, American Chemical Society, Washington, DC, 1975.
- Burgess, D., W. Tsang, M. R. Zachariah, and P. R. Westmoreland. "Fluorinated Hydrocarbon Flame Suppression Chemistry." Preprints of papers presented at The American Chemical Society National Meeting (207th), pp. 141-146, San Diego, CA, 13-17 March 1994.
- Copenhagen. Revisions to "The Montreal Protocol on Substances That Deplete the Ozone Layer." 1987.
- Daniel, R. G., K. L. McNesby, and A. W. Miziolek. "A Tunable Diode Laser Study of Premixed Methane/Oxygen Flames Inhibited by Halogenated Compounds." Technical Meeting, Proceedings of the Eastern States Section, The Combustion Institute, pp. 495-498, October 1993.
- Daniel, R. G., K. L. McNesby, A. W. Miziolek, D. R. F. Burgess, Jr., P. R. Westmoreland, W. Tsang, and M. R. Zachariah. "IR Laser Absorption and Modeling Studies of Hydrocarbon Flames Inhibited by Candidate Halon Replacement Compounds." Proceedings of the 1994 Halon Options Technical Working Conference, pp. 229-240, New Mexico Engineering Research Institute, Albuquerque, NM, 1994.
- Finnerty, A. E., and S. Polyanski. "Using Powderpacks for Passive Fire Protection of Military Vehicles." Journal of Fire Science, vol. 2, pp. 242-252, 1993.
- Hanson, R. K., and P. K. Falcone. Applied Optics, vol. 17, pp. 2477-2480, 1978.
- Linteris, G. T. "Acid Gas Production in Inhibited Diffusion Flames." Halon Replacements: Technology and Science, ACS Symposium Series, edited by A. W. Miziolek and W. Tsang, in press (a).
- Linteris, G. T. "The Effect of Inhibitor Concentration on the Inhibition Mechanism of Fluoromethanes in Premixed Methane-Air Flames." ACS Symposium Series, edited by A. W. Miziolek, and W. Tsang, in press (b).
- McNesby, K. L., and R. A. Fifer. "Tomographic Analysis of Line of Sight Infrared Spectra of Low Pressure Flames." ARL-TR-108, U.S. Army Research Laboratory, Aberdeen Proving Ground, MD, April 1993.
- Miziolek, A. W., A. E. Finnerty, R. G. Daniel, K. L. McNesby, W. Tsang, V. I. Babushok, M. R. Zachariach, P. R. Westmoreland, and D. R. F. Burgess, Jr. "Fundamental Studies of Fire Extinguishment for Predicting Halon Alternative Compound Behavior." Proceedings of the 1994 Army Science Conference, in press.
- Ouyang, X., P. L. Varghese, and D. S. Cline. Advances in Laser Science IV. American Institute of Physics, p. 750, edited by J. L. Gole, D. F. Heller, M. Lapp, and W. C. Swalley, New York, 1989.
- Philipczak, R. A. "Relative Extinguishment Effectiveness and Agent Decomposition Products of Halon Alternative Agents." Proceedings of the 1993 Halon Options Technical Working Conference, pp. 149-159, New Mexico Engineering Research Institute, Albuquerque, NM, 1993.

- Safieh, H. Y., J. Vandooren, and P. J. Tiggelin. "Experimental Study of Inhibition Induced by  $\text{CF}_3\text{Br}$  in a  $\text{CO-H}_2\text{-O}_2\text{-Ar}$  Flame." Nineteenth Symposium (International) on Combustion, The Combustion Institute, pp. 117–126, 1982.
- Sheinson, R. S., J. K. Musick, and H. W. Carhart. Journal of Fire and Flammability, vol. 12, pp. 229–235, 1981.
- Solomon, P. R., R. M. Carangelo, D. G. Hamblen, and P. E. Best. "Infrared Analysis of Particulates by FTIR Emission/Transmission Spectroscopy." Applied Spectroscopy, vol. 40, pp. 746–759, 1986.



<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>
2	ADMINISTRATOR ATTN DTIC DDA DEFENSE TECHNICAL INFO CTR CAMERON STATION ALEXANDRIA VA 22304-6145

1	DIRECTOR ATTN AMSRL OP SD TA US ARMY RESEARCH LAB 2800 POWDER MILL RD ADELPHI MD 20783-1145
---	---

3	DIRECTOR ATTN AMSRL OP SD TL US ARMY RESEARCH LAB 2800 POWDER MILL RD ADELPHI MD 20783-1145
---	---

1	DIRECTOR ATTN AMSRL OP SD TP US ARMY RESEARCH LAB 2800 POWDER MILL RD ADELPHI MD 20783-1145
---	---

ABERDEEN PROVING GROUND

5	DIR USARL ATTN AMSRL OP AP L (305)
---	---------------------------------------

NO. OF COPIES	ORGANIZATION
1	HQDA ATTN SARD TT DR F MILTON PENTAGON WASHINGTON DC 20310-0103
1	HQDA ATTN SARD TT MR J APPEL PENTAGON WASHINGTON DC 20310-0103
1	HQDA OASA RDA ATTN DR C H CHURCH PENTAGON ROOM 3E486 WASHINGTON DC 20310-0103
4	COMMANDER US ARMY RESEARCH OFFICE ATTN R GHIRARDELLI D MANN R SINGLETON R SHAW P O BOX 12211 RSCH TRNGLE PK NC 27709-2211
1	DIRECTOR ARMY RESEARCH OFFICE ATTN AMXRO MCS K CLARK P O BOX 12211 RSCH TRNGLE PK NC 27709-2211
1	DIRECTOR ARMY RESEARCH OFFICE ATTN AMXRO RT IP LIB SERVICES P O BOX 12211 RSCH TRNGLE PK NC 27709-2211
2	COMMANDER US ARMY ARDEC ATTN SMCAR AEE B D S DOWNS PCTNY ARSNL NJ 07806-5000
2	COMMANDER US ARMY ARDEC ATTN SMCAR AEE J A LANNON PCTNY ARSNL NJ 07806-5000
1	COMMANDER US ARMY ARDEC ATTN SMCAR AEE BR L HARRIS PCTNY ARSNL NJ 07806-5000

NO. OF COPIES	ORGANIZATION
2	COMMANDER US ARMY MISSILE COMMAND ATTN AMSMI RD PR E A R MAYKUT AMSMI RD PR P R BETTS REDSTONE ARSENAL AL
1	OFFICE OF NAVAL RESEARCH DEPARTMENT OF THE NAVY ATTN R S MILLER CODE 432 800 N QUINCY STREET ARLINGTON VA 22217
1	COMMANDER NAVAL AIR SYSTEMS COMMAND ATTN J RAMNARACE AIR 54111C WASHINGTON DC 20360
2	COMMANDER NAVAL SURFACE WARFARE CENTER ATTN R BERNECKER R 13 G B WILMOT R 16 SILVER SPRING MD 20903-5000
5	COMMANDER NAVAL RESEARCH LABORATORY ATTN M C LIN J MCDONALD E ORAN J SHNUR R J DOYLE CODE 6110 WASHINGTON DC 20375
2	COMMANDER NAVAL WEAPONS CENTER ATTN T BOGGS CODE 388 T PARR CODE 3895 CHINA LAKE CA 93555-6001
1	SUPERINTENDENT NAVAL POSTGRADUATE SCHOOL DEPT OF AERONAUTICS ATTN D W NETZER MONTEREY CA 93940
3	AL LSCF ATTN R CORLEY R GEISLER J LEVINE EDWARDS AFB CA 93523-5000

NO. OF  
COPIES   ORGANIZATION

1   AFSR  
ATTN J M TISHKOFF  
BOLLING AIR FORCE BASE  
WASHINGTON DC 20332

1   OSD SDIO IST  
ATTN L CAVENY  
PENTAGON  
WASHINGTON DC 20301-7100

1   COMMANDANT  
USAFAS  
ATTN ATSF TSM CN  
FORT SILL OK 73503-5600

1   UNIV OF DAYTON RSCH INSTITUTE  
ATTN D CAMPBELL  
AL PAP  
EDWARDS AFB CA 93523

1   NASA  
LANGLEY RESEARCH CENTER  
ATTN G B NORTHAM MS 168  
LANGLEY STATION  
HAMPTON VA 23365

4   NATIONAL BUREAU OF STANDARDS  
US DEPARTMENT OF COMMERCE  
ATTN J HASTIE  
M JACOX  
T KASHIWAGI  
H SEMERJIAN  
WASHINGTON DC 20234

2   DIRECTOR  
LAWRENCE LIVERMORE NATIONAL LAB  
ATTN C WESTBROOK  
W TAO MS L 282  
P O BOX 808  
LIVERMORE CA 94550

1   DIRECTOR  
LOS ALAMOS NATIONAL LAB  
ATTN B NICHOLS T7 MS B284  
P O BOX 1663  
LOS ALAMOS NM 87545

NO. OF  
COPIES   ORGANIZATION

2   PRINCETON COMBUSTION  
RESEARCH LABORATORIES INC  
ATTN N A MESSINA  
M SUMMERFIELD  
PRINCETON CORPORATE PLAZA  
BLDG IV SUITE 119  
11 DEERPARK DRIVE  
MONMOUTH JUNCTION NJ 08852

3   DIRECTOR  
SANDIA NATIONAL LABORATORIES  
DIVISION 8354  
ATTN S JOHNSTON  
P MATTERN  
D STEPHENSON  
LIVERMORE CA 94550

1   BRIGHAM YOUNG UNIVERSITY  
DEPT OF CHEMICAL ENGINEERING  
ATTN M W BECKSTEAD  
PROVO UT 84058

1   CALIFORNIA INSTITUTE OF TECH  
JET PROPULSION LABORATORY  
ATTN L STRAND MS 125 224  
4800 OAK GROVE DRIVE  
PASADENA CA 91109

1   CALIFORNIA INSTITUTE OF TECHNOLOGY  
ATTN F E C CULICK MC 301 46  
204 KARMAN LAB  
PASADENA CA 91125

1   UNIVERSITY OF CALIFORNIA  
LOS ALAMOS SCIENTIFIC LAB  
P O BOX 1663 MAIL STOP B216  
LOS ALAMOS NM 87545

1   UNIVERSITY OF CALIFORNIA BERKELEY  
CHEMISTRY DEPARMENT  
ATTN C BRADLEY MOORE  
211 LEWIS HALL  
BERKELEY CA 94720

1   UNIVERSITY OF CALIFORNIA SAN DIEGO  
ATTN F A WILLIAMS  
AMES B010  
LA JOLLA CA 92093

<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>	<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>
2	UNIV OF CALIFORNIA SANTA BARBARA QUANTUM INSTITUTE ATTN K SCHOFIELD M STEINBERG SANTA BARBARA CA 93106	1	THE JOHNS HOPKINS UNIV CPIA ATTN T W CHRISTIAN 10630 LITTLE PATUXENT PKWY SUITE 202 COLUMBIA MD 21044-3200
1	UNIV OF COLORADO AT BOULDER ENGINEERING CENTER ATTN J DAILY CAMPUS BOX 427 BOULDER CO 80309-0427	1	UNIVERSITY OF MICHIGAN GAS DYNAMICS LAB ATTN G M FAETH AEROSPACE ENGINEERING BLDG ANN ARBOR MI 48109-2140
3	UNIV OF SOUTHERN CALIFORNIA DEPT OF CHEMISTRY ATTN R BEAUDET S BENSON C WITTIG LOS ANGELES CA 90007	1	UNIVERSITY OF MINNESOTA DEPT OF MECHANICAL ENGINEERING ATTN E FLETCHER MINNEAPOLIS MN 55455
1	CORNELL UNIVERSITY DEPARTMENT OF CHEMISTRY ATTN T A COOL BAKER LABORATORY ITHACA NY 14853	4	PENNSYLVANIA STATE UNIVERSITY DEPT OF MECHANICAL ENGINEERING ATTN K KUO M MICCI S THYNELL V YANG UNIVERSITY PARK PA 16802
1	UNIVERSITY OF DELAWARE CHEMISTRY DEPARTMENT ATTN T BRILL NEWARK DE 19711	2	PRINCETON UNIVERSITY FORRESTAL CAMPUS LIBRARY ATTN K BREZINSKY I GLASSMAN P O BOX 710 PRINCETON NJ 08540
1	UNIVERSITY OF FLORIDA DEPT OF CHEMISTRY ATTN J WINEFORDNER GAINESVILLE FL 32611	1	PURDUE UNIVERSITY SCHL OF AERONAUTICS & ASTRONAUTICS ATTN J R OSBORN GRISSOM HALL WEST LAFAYETTE IN 47906
3	GEORGIA INSTITUTE OF TECHNOLOGY SCHOOL OF AEROSPACE ENGINEERING ATTN E PRICE W C STRAHLE B T ZINN ATLANTA GA 30332	1	PURDUE UNIVERSITY DEPARTMENT OF CHEMISTRY ATTN E GRANT WEST LAFAYETTE IN 47906
1	UNIVERSITY OF ILLINOIS DEPT OF MECH ENG ATTN H KRIER 144MEB 1206 W GREEN ST URBANA IL 61801	2	PURDUE UNIVERSITY SCHL OF MECHANICAL ENGNRNG ATTN N M LAURENDEAU S N B MURTHY TSPC CHAFFEE HALL WEST LAFAYETTE IN 47906

<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>
1	RENSSELAER POLYTECHNIC INST DEPT OF CHEMICAL ENGINEERING ATTN A FONTIJN TROY NY 12181
1	STANFORD UNIVERSITY DEPT OF MECHANICAL ENGINEERING ATTN R HANSON STANFORD CA 94305
1	UNIVERSITY OF TEXAS DEPT OF CHEMISTRY ATTN W GARDINER AUSTIN TX 78712
1	VA POLYTECH INST AND STATE UNIV ATTN J A SCHETZ BLACKSBURG VA 24061
1	APPLIED COMBUSTION TECHNOLOGY INC ATTN A M VARNEY P O BOX 607885 ORLANDO FL 32860
2	APPLIED MECHANICS REVIEWS ASME ATTN R E WHITE & A B WENZEL 345 E 47TH STREET NEW YORK NY 10017
1	TEXTRON DEFENSE SYSTEMS ATTN A PATRICK 2385 REVERE BEACH PARKWAY EVERETT MA 02149-5900
1	BATTELLE TWSTIAC 505 KING AVENUE COLUMBUS OH 43201-2693
1	COHEN PROFESSIONAL SERVICES ATTN N S COHEN 141 CHANNING STREET REDLANDS CA 92373
1	EXXON RESEARCH & ENG CO ATTN A DEAN ROUTE 22E ANNANDALE NJ 08801

<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>
1	GENERAL APPLIED SCIENCE LABS INC 77 RAYNOR AVENUE RONKONKAMA NY 11779-6649
1	GENERAL ELECTRIC ORDNANCE SYSTEMS ATTN J MANDZY 100 PLASTICS AVENUE PITTSFIELD MA 01203
1	GENERAL MOTORS RSCH LABS PHYSICAL CHEMISTRY DEPARTMENT ATTN T SLOANE WARREN MI 48090-9055
2	HERCULES INC ATTN W B WALKUP E A YOUNT P O BOX 210 ROCKET CENTER WV 26726
1	HERCULES INC ATTN R V CARTWRIGHT 100 HOWARD BLVD KENVIL NJ 07847
1	ALLIANT TECHSYSTEMS INC MARINE SYSTEMS GROUP ATTN D E BRODEN MS MN50 2000 600 2ND STREET NE HOPKINS MN 55343
1	ALLIANT TECHSYSTEMS INC ATTN R E TOMPKINS MN 11 2720 600 SECOND ST NORTH HOPKINS MN 55343
1	IBM CORPORATION RESEARCH DIVISION ATTN A C TAM 5600 COTTLE ROAD SAN JOSE CA 95193
1	IIT RESEARCH INSTITUTE ATTN R F REMALY 10 WEST 35TH STREET CHICAGO IL 60616

<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>
1	LOCKHEED MISSILES & SPACE CO ATTN GEORGE LO 3251 HANOVER STREET DEPT 52 35 B204 2 PALO ALTO CA 94304
1	OLIN ORDNANCE ATTN V MCDONALD LIBRARY P O BOX 222 ST MARKS FL 32355-0222
1	PAUL GOUGH ASSOCIATES INC ATTN P S GOUGH 1048 SOUTH STREET PORTSMOUTH NH 03801-5423
1	HUGHES AIRCRAFT COMPANY ATTN T E WARD 8433 FALLBROOK AVENUE CANOGA PARK CA 91303
1	ROCKWELL INTERNATIONAL CORP ROCKETDYNE DIVISION ATTN J E FLANAGAN HB02 6633 CANOGA AVENUE CANOGA PARK CA 91304
1	SCIENCE APPLICATIONS INC ATTN R B EDELMAN 23146 CUMORAH CREST WOODLAND HILLS CA 91364
3	SRI INTERNATIONAL ATTN G SMITH D CROSLEY D GOLDEN 333 RAVENSWOOD AVENUE MENLO PARK CA 94025
1	STEVENS INSTITUTE OF TECH DAVIDSON LABORATORY ATTN R MCALEVY III HOBOKEN NJ 07030
1	SVERDRUP TECHNOLOGY INC LERC GROUP ATTN R J LOCKE MS SVR 2 2001 AEROSPACE PARKWAY BROOK PARK OH 44142

<u>NO. OF COPIES</u>	<u>ORGANIZATION</u>
1	SVERDRUP TECHNOLOGY INC ATTN J DEUR 2001 AEROSPACE PARKWAY BROOK PARK OH 44142
3	THIOKOL CORPORATION ELKTON DIVISION ATTN R BIDDLE R WILLER TECH LIB P O BOX 241 ELKTON MD 21921
3	THIOKOL CORPORATION WASATCH DIVISION ATTN S J BENNETT P O BOX 524 BRIGHAM CITY UT 84302
1	UNITED TECHNOLOGIES RSCH CENTER ATTN A C ECKBRETH EAST HARTFORD CT 06108
1	UNITED TECHNOLOGIES CORP CHEMICAL SYSTEMS DIVISION ATTN R R MILLER P O BOX 49028 SAN JOSE CA 95161-9028
1	UNIVERSAL PROPULSION COMPANY ATTN H J MCSPADDEN 25401 NORTH CENTRAL AVENUE PHOENIX AZ 85027-7837
1	VERITAY TECHNOLOGY INC ATTN E B FISHER 4845 MILLERSPORT HIGHWAY EAST AMHERST NY 14051-0305
1	FREEDMAN ASSOCIATES ATTN E FREEDMAN 2411 DIANA ROAD BALTIMORE MD 21209-1525
4	ALLIANT TECHSYSTEMS ATTN C CANDLAND L OSGOOD R BECKER M SWENSON 600 SECOND ST NE HOPKINS MN 55343

NO. OF  
COPIES    ORGANIZATION

1    US ARMY BENET LABORATORY  
ATTN SAM SOPOK  
SMCAR CCB B  
WATERVLIET NY 12189

ABERDEEN PROVING GROUND

36    DIR USARL  
ATTN:    AMSRL-WT-P, A HORST  
         AMSRL-WT-PC,  
         R A FIFER  
         G F ADAMS  
         W R ANDERSON  
         R A BEYER  
         S W BUNTE  
         C F CHABALOWSKI  
         K P MCNEILL-BOONSTOPPEL  
         A COHEN  
         R CUMPTON  
         R DANIEL  
         D DEVYNCK  
         N F FELL  
         B E FORCH  
         J M HEIMERL  
         A J KOTLAR  
         M R MANAA  
         W F MCBRATNEY  
         K L MCNESBY  
         S V MEDLIN  
         M S MILLER  
         A W MIZIOLEK  
         S H MODIANO  
         J B MORRIS  
         J E NEWBERRY  
         S A NEWTON  
         R A PESCE-RODRIGUEZ  
         B M RICE  
         R C SAUSA  
         M A SCHROEDER  
         J A VANDERHOFF  
         M WENSING  
         A WHREN  
         J M WIDDER  
         C WILLIAMSON  
         AMSRL-CI-CA, R PATEL

INTENTIONALLY LEFT BLANK.



## USER EVALUATION SHEET/CHANGE OF ADDRESS

This Laboratory undertakes a continuing effort to improve the quality of the reports it publishes. Your comments/answers to the items/questions below will aid us in our efforts.

1. ARL Report Number ARL-TR-857 Date of Report September 1995
2. Date Report Received \_\_\_\_\_
3. Does this report satisfy a need? (Comment on purpose, related project, or other area of interest for which the report will be used.) \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_
4. Specifically, how is the report being used? (Information source, design data, procedure, source of ideas, etc.) \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_
5. Has the information in this report led to any quantitative savings as far as man-hours or dollars saved, operating costs avoided, or efficiencies achieved, etc? If so, please elaborate. \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_
6. General Comments. What do you think should be changed to improve future reports? (Indicate changes to organization, technical content, format, etc.) \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

CURRENT  
ADDRESS

\_\_\_\_\_  
Organization

\_\_\_\_\_  
Name

\_\_\_\_\_  
Street or P.O. Box No.

\_\_\_\_\_  
City, State, Zip Code

7. If indicating a Change of Address or Address Correction, please provide the Current or Correct address above and the Old or Incorrect address below.

OLD  
ADDRESS

\_\_\_\_\_  
Organization

\_\_\_\_\_  
Name

\_\_\_\_\_  
Street or P.O. Box No.

\_\_\_\_\_  
City, State, Zip Code

(Remove this sheet, fold as indicated, tape closed, and mail.)  
(DO NOT STAPLE)